


The following guidelines apply to gasoline and LPG filling stations services to all other hazardous areas shall be designed by the Division Engineer.

PNM equipment shall not be closer than distance "A" (measured horizontally) from pumps, filler pipes, tanks, vent pipes, compressors and dispensing equipment.

Example: Gasoline pumps (dispensing equipment)

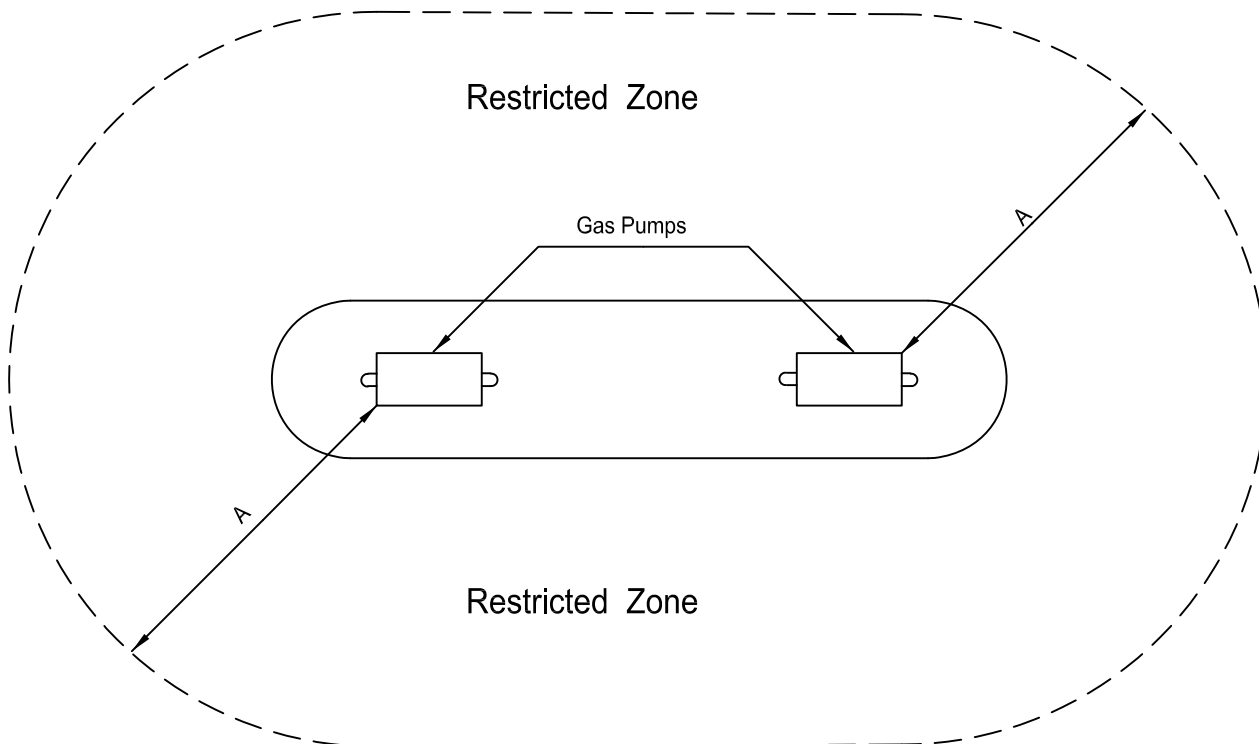

	Minimum Horizontal Distance "A" (Feet)
Service drops, area lighting, metering equipment	20
Primary & Secondary Overhead Conductors	10

REFERENCES

- (1) See DS-13-8.0 Service for Hazardous Areas