REVISION	Updated Approved Material list

PNM
METER
STANDARD

A
(Overhead)

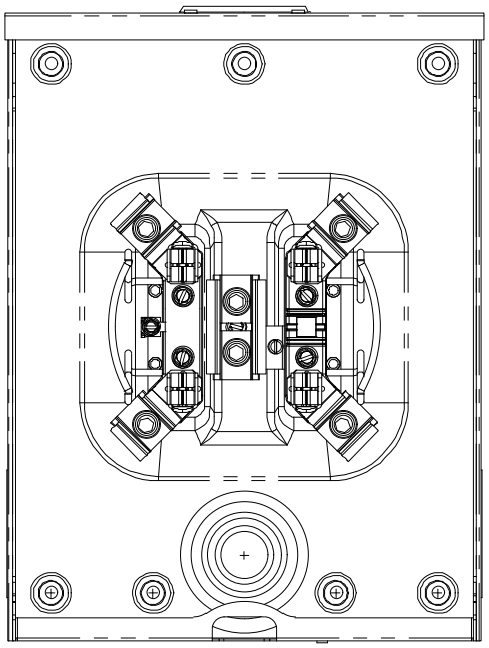

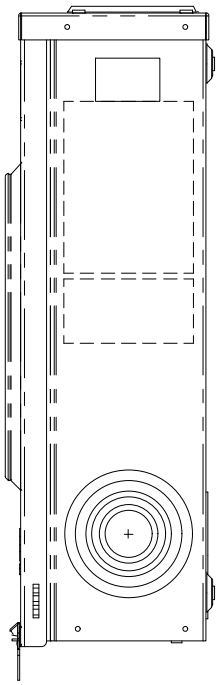

Allowable Uses

- 120/240 V Permanent/Temporary Services ONLY

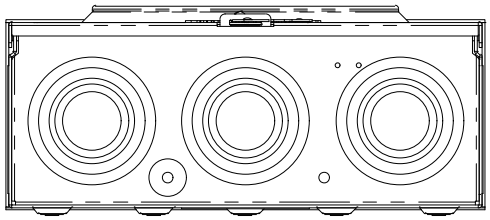

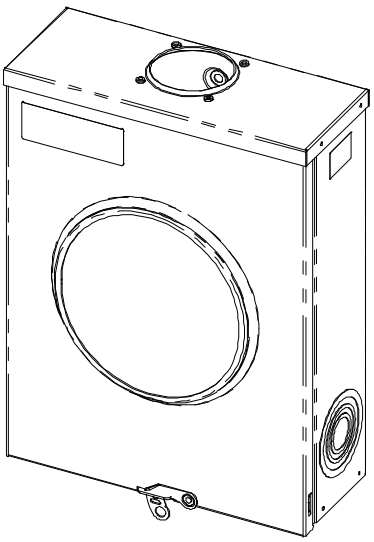

NOTES

(1) Socket to be Underwriters Laboratory (UL) listed.
(2) Connections for terminating service conductors shall be the lay-in type lug.
(3) Service conduit to enter at point "A"
(4) Meter shall be 4' - 5' 6" from finished grade.
(5) Commercial application for non-critical loads i.e. sprinkler control and gates. PNM will allow socket without bypass handle.
(6) PNM does not permit a trough ahead of meter socket.
(7) Metering and instrument cabinets shall not be used to house Customer-owned equipment, such as distribution panels or other equipment, nor used as a junction box/trough for the distribution of circuits.
(8) Customer building numbers must be permanently painted on proper meter panels.

REFERENCES

(1) See DS-4-6.0 120/240V Underground Service Pole
(2) See DS-4-8.0 Overhead Permanent/Temporary Single-Phase or Temporary Three-Phase Service Pole
(3) See DS-4-9.0 Underground Residential Customer-Owned Service
(4) See DM-4-11.0 Maximum Available Fault Current
(5) See MS-3-7.0 Over 320A 240V Single-Phase Meter

Approved Equipment		
Manufacturer	Item	Mfg Part #
Eaton	200A OH Ringless Socket	UTRS202BCH
Eaton	200A OH/UG Ringless Socket	UTRS212BCH
Eaton	200A OH/UG Ringless Socket	UTRS213BE
Milbank	200A OH Ringless Socket	U7021-RL-TG
Milbank	200A OH Ringless Socket	U7040-RL-TG
Milbank	200A OH/UG Ringless Socket	U7040-XL-TG
Milbank	200A OH/UG Ringless Socket	U4801-XL-5T9
Milbank	200A OH/UG Ringless Socket	U8173-XL-KK-BLG
Siemens	200A OH Ringless Socket	SUAT317-0G
Siemens	200A OH Ringless Socket	UAT317-0G
Square D	200A OH Ringless Socket	UTRS202B
Square D	200A UG Ringless Socket	RU816F200PS
Square D	200A UG Ringless Socket	RU816M200PS
Square D	200A UG Ringless Socket	RU48F200PS
Square D	200A UG Ringless Socket	QU816F200PS
Square D	200A UG Ringless Socket	QU816M200PS
Square D	200A UG Ringless Socket	QU48F200PS
Square D	200A OH/UG Ringless Socket	UTH7213T
Square D	200A OH/UG Ringless Socket (5th Jaw to be removed)	UTH5213T
Talon	200A OH Ringless Socket	UAT417-XGF

For ease of checking service without interruption, PNM will no longer allow ring meter sockets as of 12/01/2013.

240V 200A Customer Overhead or Underground Single-Phase Meter Socket

MS-2-2.5

Not to Scale

08/01/24 E